PIR Standalone Motion Sensor with **Bluetooth** Mesh

HBIR30/CA

Casambi Enabled



Product Description

HBIR30/CA is a Bluetooth PIR standalone motion sensor. It is ideal for typical indoor applications such as office, classroom, healthcare and other commercial areas. HBIR30/CA works with CBU-ASD module for either 1-10V or DALI output. Meanwhile, all commissioning and settings can be done via **CASAMBI** app.



Hardware Features

1 push input for flexible manual control

Surface mount kit available as accessory

Two types of PIR lens and blinds

User-friendly design for installation

Use Casambi app for commissioning

High bay version available (up to 20m in height)

• Device firmware update over-the-air

5 5-year warranty

Free smartphone App for set-up and commissioning





Technical Specifications

Input & Output Characteristics	
Mains voltage	220~240VAC 50/60Hz
Stand-by power	<0.2W
Warming-up	20s

Sensor Data	
Sensor principle	PIR detection
Detection range	(∅ x H) 12m x 3m (max)
Detection angle	360°
Mounting height	3 m


Bluetooth Transceiver		
Operation frequency	2.4 GHz - 2.483 GHz	
Transmission power	Max 4 dBm	
Range (Typical indoor)	10~30m	
Protocol	⊗ Bluetooth [®] 4. O	


Safety & EMC	
EMC standard (EMC)	EN55015, EN61000, EN61547
Safety standard (LVD)	EN60669-1, EN60669-2-1
Certification	CB, CE , EMC, LVD, RCM
RED	EN300328, EN301489-1, EN301489-17

Environment	
Operation temperature	Ta:-20°C ~ +50°C
IP rating	IP20

Edition: 26 Feb. 2020

Mechanical Structure & Dimensions

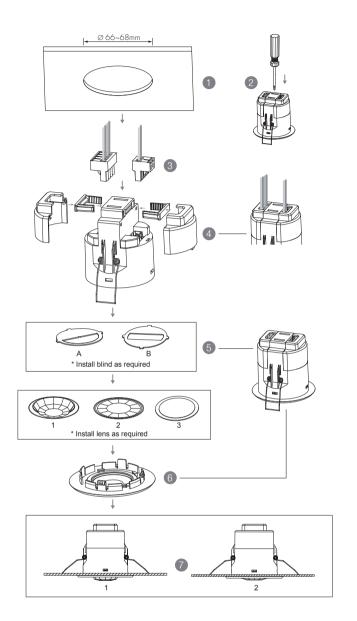




- 1. Ceiling (drill hole Ø 66~68mm)
- 2. Carefully prise off the cable clamps.
- 3. Make connections to the pluggable terminal blocks.
- 4. Insert plug connectors and secure using the provided cable clamps, then clip terminal covers to the base.
- 5. Fit detection blind (if required) and desired lens.
- 6. Clip fascia to body.
- 7. Bend back springs and insert into ceiling.

Wire Preparation







Pluggable screw terminal. It is recommended to make connections to the terminal before fitting to the sensor.

Subject to change without notice. Edition: 26 Feb. 2020 Ver. AO Page 2/5


Wiring Diagram

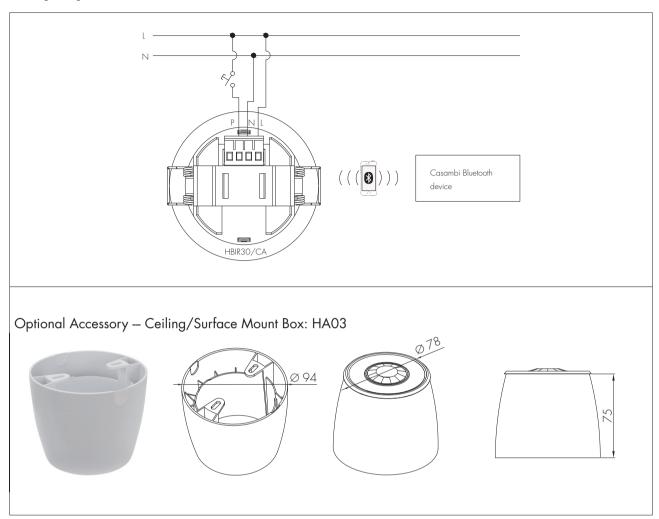


Detection Pattern

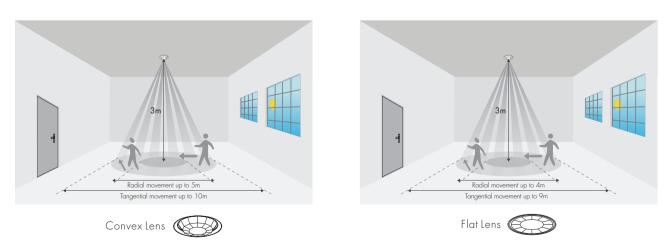

Subject to change without notice. Edition: 26 Feb. 2020 Ver. AO Page 3/5

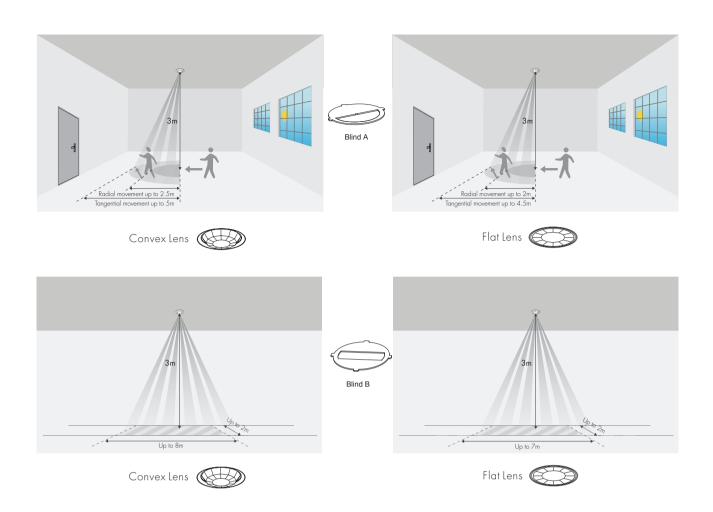

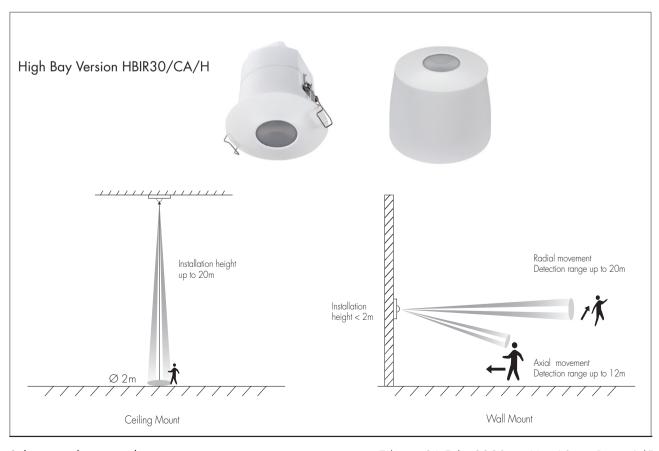

Subject to change without notice.

Additional Information / Documents

- 1. Data sheet is subject to change without notice. Please always refer to the most recent release on www.hytronik.com/products/bluetooth technology ->Partnership
- 3. Regarding Hytronik standard guarantee policy, please refer to www.hytronik.com/download/knowledge ->Hytronik Standard Guarantee Policy

Subject to change without notice. Edition: 26 Feb. 2020 Ver. AO Page 5/5